



United Printing




- Notes:
- 1 All A.C. Watermain to be Class 150
 - 2 All Pipe installation lengths shown on plans are from center to center of fittings
 - 3 Fence Removal & Replacement and Tree Removal on Sheets 2 & 3 to be considered incidental to pipeline installation
 - 4 Gate Valves for Hydrants to be placed approx. 3' from Hydrant
 - 5 The following quantities are to be included for the various Hydrant Installations:
 Hydrant Type 'A' - 6" Tee, 10 LF 6" A.C. Watermain, 6" Gate Valve & 5" Hydrant w/ 6" Hub
 Hydrant Type 'B' - 8" Tee, 10 LF 8" A.C. Watermain, 8" Gate Valve & 6" Hydrant w/ 8" Hub
 Hydrant Type 'C' - 12" Tee, 12' to 8" Reducer, 10 LF 8" A.C. Watermain, 8" Gate Valve & 6" Hydrant w/ 8" Hub
 - 6 6" Min. Cover for Forcemain
 - 7 8" Min. Cover for Watermain


Hookup Detail

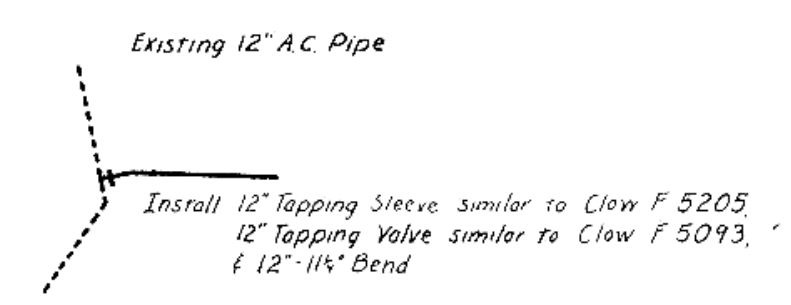

Railroad Crossing Detail
 Scale 1"=10'

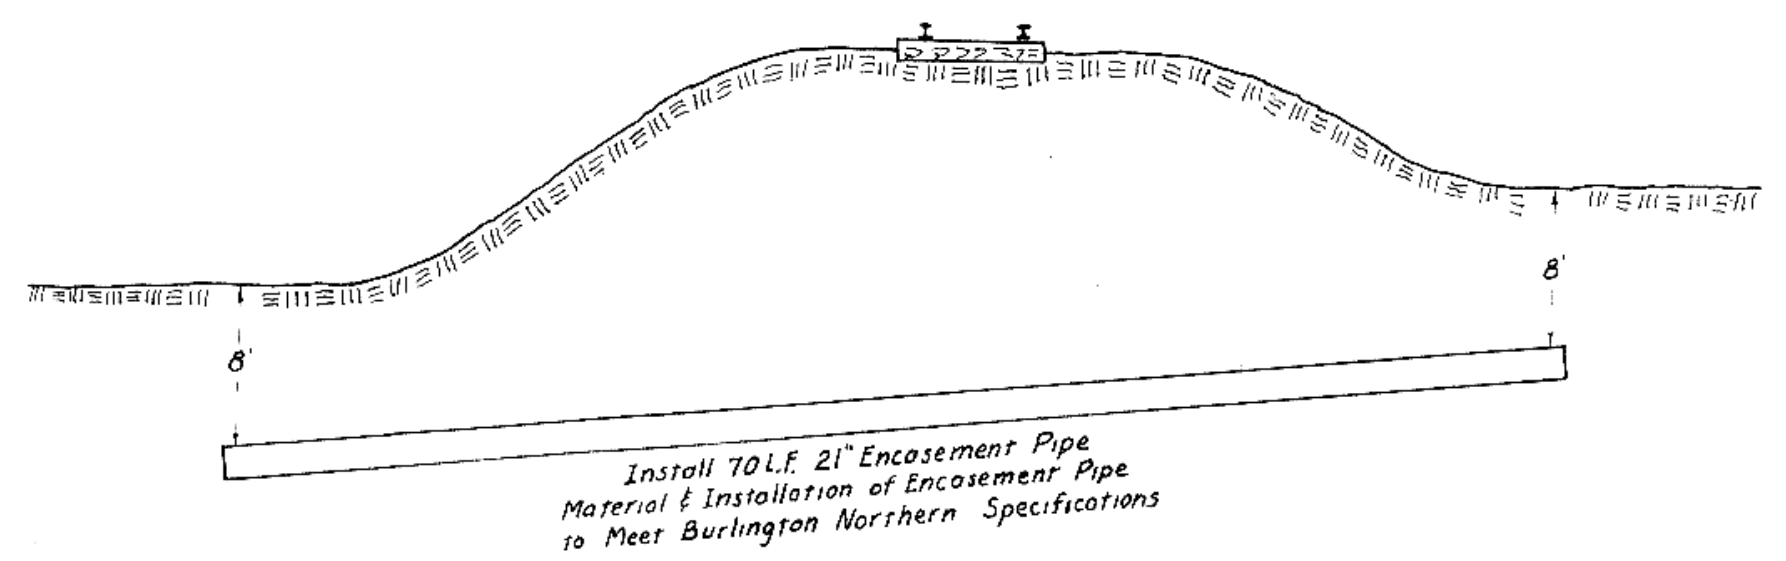

Highway Crossing Detail
 Scale 1"=10'

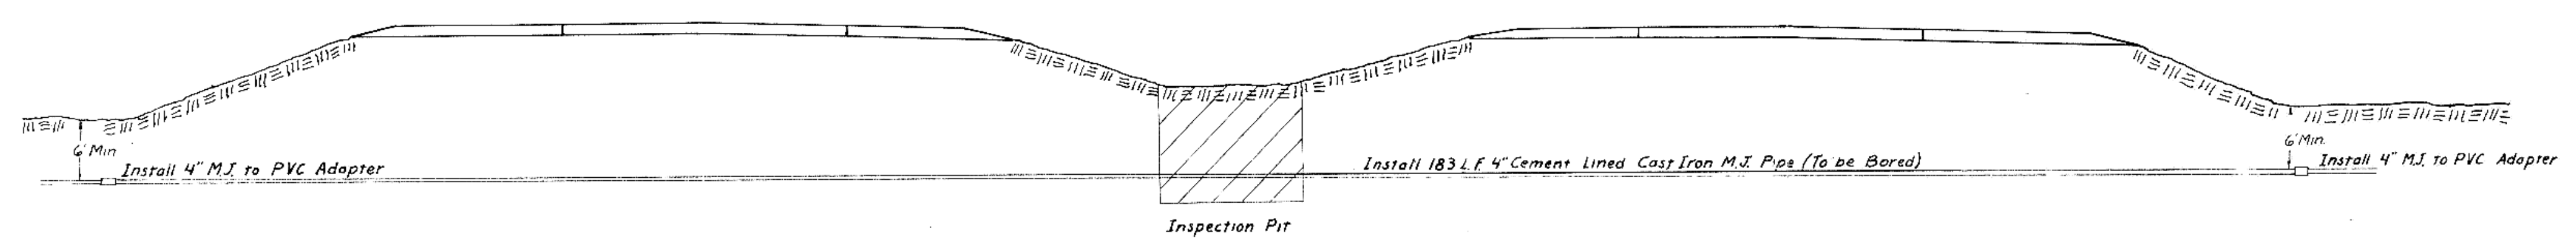

PROJECT AREA NO. 2